

**Test Report**FOR: **LATICRETE International, Inc.**  
Bethany, CT.**Floor Covering Impact Reduction**  
**RAL™-IFC15-005**

CONDUCTED: 2015-07-30

Page 1 of 8

ON: 5/16 inch Porcelain Tile over Fracture Ban™ 90 Peel &amp; Stick Membrane

**TEST METHOD**

Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure (NVLAP Lab Code: 100227-0). The test reported in this document conformed explicitly with ASTM E2179-03 (2009): "Standard Test Method for Laboratory Measurement of the Effectiveness of Floor Coverings in Reducing Impact Sound Transmission Through Concrete Floors". The single number rating was calculated according to ASTM E989-06 (2012): "Standard Classification for Determination of Impact Insulation Class (IIC)." The measurements were recorded using a real time analyzer and a rotating microphone boom incorporating a spatial average. The rotation speed of the boom was set at 64 seconds per revolution and the linear integration time of the analyzer was set at 160 seconds. The impact sound pressure levels (ISPL) were measured for each of the twenty-one standard one-third octave bands from 50 Hz through 5000 Hz for both the standard concrete slab and the provided specimen. The laboratory's standard concrete floor is a fully cured 152.40 mm (6.0 in.) thick concrete floor installed directly in the laboratory's 4.27 m (14.0 ft.) by 6.10 m (20.0 ft.) test opening. A complete description of the measuring procedure and room qualifications is available upon request.

**DESCRIPTION OF THE SPECIMEN**

The test specimen was designated by the manufacturer as 5/16 inch Porcelain Tile over Fracture Ban™ 90 Peel & Stick Membrane. The building contractor and RAL staff compiled a detailed construction specification as follows:

**Flooring**

---

Layer 1: Crossville unglazed porcelain tile and Laticrete Permacolor® Grout

Weight: 497.02 kg (1095.75 lbs.)

Mass per Unit Area: 19.11 kg/m<sup>2</sup> (3.91 lbs./ft<sup>2</sup>)

*The dimensions of each tile were measured as 298.45 mm (11.75 in.) wide by 298.45 mm (11.75 in.) long and 8.38 mm (0.33 in.) thick. The tile series was Cross Colors. The color was A825 Mercury. The individual weights of the tile and grout were 480.01 kg (1058.25 lbs.) and 17.01 kg (37.50 lbs.), respectively.*

Layer 2: Laticrete 253 Gold Mortar

Weight: 109.77 kg (242.0 lbs.)

Mass per Unit Area: 4.22 kg/m<sup>2</sup> (0.86 lbs./ft<sup>2</sup>)

Layer 3: Laticrete Fracture Ban™ 90 peel and stick membrane

Thickness: 2.90 mm (0.11 in.)



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

**Test Report****LATICRETE International, Inc.**  
2015-07-30**RAL™-IFC15-005**  
Page 2 of 8**Flooring (Continued)**

---

Weight: 45.13 kg (99.50 lbs.)

Mass per Unit Area: 1.74 kg/m<sup>2</sup> (0.36 lbs./ft<sup>2</sup>)

*Note: Note: The membrane was laid over the 152.40 mm (6.0 in.) concrete labs. The mortar was then applied over the membrane using a trowel. Tile was set in the mortar bed with a 6.35 mm (0.25 in.) grout joint. The mortar was allowed to cure for at least 24 hours before grouting. The flooring was then allowed to cure for at least 21 day prior to testing.*

**Concrete Slab**

---

Overall Size: Ten at 609.60 mm (24.0 in.) wide by 4.23 m (166.50 in.) long

Overall Thickness: 152.40 mm (6.0 in.)

Material: Wire-reinforced concrete

Weight: 8640.93 kg (19,050.0 lbs.)

Mass per Unit Area: 332.22 kg/m<sup>2</sup> (68.04 lbs./ft<sup>2</sup>)

Joints: Sealed with acoustical caulk (underside)

Filled with general purpose sand, sealed with ready mix compound.

**Physical Measures**

---

Size: 4.27 m (168.00) wide by 6.10 m (240.00) long

Thickness: 163.68 mm (6.44 in.)

Weight: 9292.84 kg (20487.25 lbs.)

Mass per Unit Area: 357.25 kg/m<sup>2</sup> (73.17 lbs./ft<sup>2</sup>)Transmission Area: 26.01 m<sup>2</sup> (280.00 ft<sup>2</sup>)**Test Aperture**

---

Size: 4.27 m (14.0 ft.) by 6.10 m (20.0 ft.)

Filler Wall: None

Sealed: Entire periphery (both sides) with dense mastic

**Test Environment**

---

## Source Room

Volume: 139.4 m<sup>3</sup> (4,923.6 ft<sup>3</sup>)

Temperature: 23±0°C (74±1°F)

Humidity: 53±1%

## Receive Room

Volume: 87.0 m<sup>3</sup> (3,072.7 ft<sup>3</sup>)

Temperature: 23±0°C (74±1°F)

Humidity: 54±0%



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

## Test Report

LATICRETE International, Inc.  
2015-07-30

RAL™-IFC15-005  
Page 3 of 8



Figure 1 – Specimen mounted in the test opening.



Figure 2 – Fracture Ban™ 90 membrane placed over concrete slabs.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.



## Test Report

LATICRETE International, Inc.  
2015-07-30

RAL™-IFC15-005  
Page 4 of 8



Figure 3 – Detail of Fracture Ban™ 90 membrane



Figure 4 – Detail of tile set in mortar.



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

1512 S BATAVIA AVENUE  
GENEVA, IL 60134  
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## Test Report

**LATICRETE International, Inc.**  
2015-07-30

**RAL™-IFC15-005**  
Page 5 of 8

### TEST RESULTS

1/3 Octave Center Frequency (Hz)	Impact SPL, $L_o$ , Bare Standard Concrete Floor (dB)	Impact SPL, $L_c$ , Floor Covering Installed (dB)	Reduction in Impact SPL, $L_d$ , ( $L_o - L_c$ ), (dB)	Impact SPL of Floor Covering on a Reference Concrete Slab, $L_{ref, c}$ , (dB)
100	69.0	68.0	1.0	66.0
125	66.0	64.0	2.0	65.5
160	67.0	66.0	1.0	67.0
200	71.0	68.0	3.0	65.5
250	70.0	69.0	1.0	68.0
315	72.0	71.0	1.0	68.5
400	70.0	70.0	0.0	70.0
500	71.0	73.0	-2.0	72.5
630	71.0	71.0	0.0	71.0
800	71.0	64.0	7.0	64.5
1000	72.0	62.0	10.0	62.0
1250	74.0	61.0	13.0	59.0
1600	74.0	57.0	17.0	55.0
2000	75.0	53.0	22.0	50.0
2500	75.0	50.0	25.0	47.0
3150	75.0	46.0	29.0	43.0

Increase in Impact Insulation Class  $\Delta IIC = 17$

Impact Insulation Class,  $IIC_c$  for  $L_{ref, c}$

$IIC_c = 45$



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.


**Test Report****LATICRETE International, Inc.**  
2015-07-30**RAL™-IFC15-005**  
Page 6 of 8**TEST RESULTS (Continued)**

The measured impact sound pressure levels (ISPL) are tabulated in each of the twenty-one standard one third octave bands from 100 Hz through 3150 Hz for both the standard concrete slab and the three sample materials. The reduction in ISPL calculated for the floor covering has been applied to a reference concrete floor with an IIC = 28 as described in the standard. The increase in impact insulation class,  $\Delta$ IIC as well as the IIC<sub>c</sub> for the floor covering on a reference concrete slab has also been calculated. An \* indicates that the value has been adjusted for background noise levels and reflects a lower limit. A graphic presentation of the data appears on the following page.


Tested by

  
Marc Sciaky  
Experimentalist

Report by

  
Chris Nottoli  
Acoustician

Approved by

  
Eric P. Wolfram  
Laboratory Manager

NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.


## Test Report

LATICRETE International, Inc.  
2015-07-30

RAL™-IFC15-005  
Page 7 of 8

### Floor Covering Impact Reduction

5/16 inch Porcelain Tile over Fracture Ban™ 90 Peel & Stick Membrane

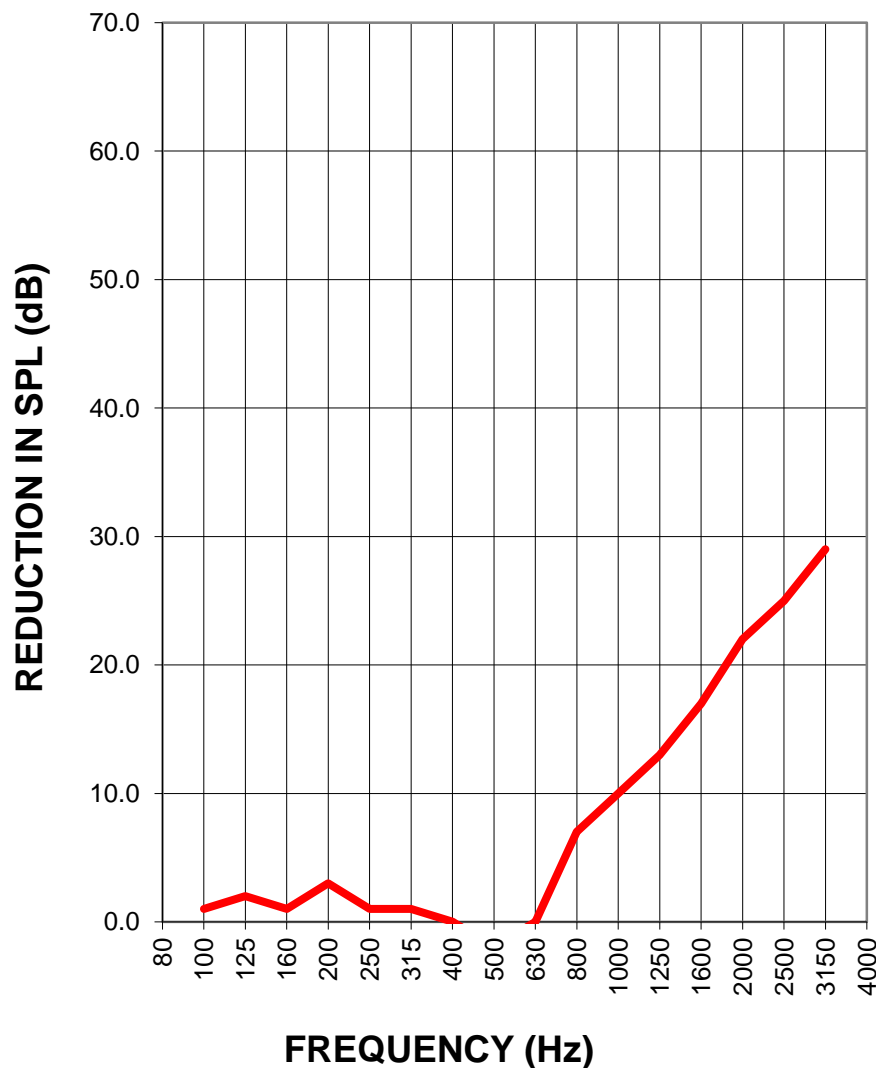

$\Delta IIC=17$

**IMPACT REDUCTION OF FLOOR COVERION  
ON A CONCRETE FLOOR**



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.

**Test Report****LATICRETE International, Inc.**  
2015-07-30**RAL™-IFC15-005**  
Page 8 of 8**APPENDIX A: Instruments of Traceability**

Specimen: 5/16 inch Porcelain Tile over Fracture Ban™ 90 Peel &amp; Stick Membrane (See Full Report)

<b><u>Description</u></b>	<b><u>Model</u></b>	<b><u>Serial Number</u></b>	<b><u>Date of Certification</u></b>	<b><u>Calibration Due</u></b>
Bruel & Kjaer Pulse Analyzer	Type 3560-C	2647140	2015-04-08	2016-04-08
Bruel & Kjaer Mic And Preamp	Type 4943-B-001	2311439	2015-03-18	2016-03-18
Bruel & Kjaer Tapping Machine	Type 3207	2724862	2014-12-02	2015-12-02
G.R.A.S Pistonphone	Type 42AF-1	80001	2014-08-06	2015-08-06
Omega Digital Thermo- Hygrometer	Model # RH411	H0102487	2014-07-31	2015-07-31
Omega Digital Thermo- Hygrometer	Model # RH411	H0101841	2014-11-28	2015-11-28

---

END



NVLAP LAB CODE 100227-0

RAL IS ACCREDITED BY THE US DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM TO ISO 17025:2005 LABORATORY QUALITY MANAGEMENT AND SPECIFIC ACOUSTICAL TEST STANDARDS. THIS TEST REPORT IN NO WAY CLAIMS OR IMPLIES PRODUCT CERTIFICATION, APPROVAL OR ENDORSEMENT BY NVLAP, NIST, OR RAL.

THIS REPORT SHALL NOT BE MODIFIED OR PARTIALLY REPRODUCED WITHOUT THE WRITTEN APPROVAL OF RAL.

THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SPECIMEN.